

Metro Water Filter of the South


Toll free 1-888-604-8043

Chlorinator Instructions

When the level in the solution tank is about 6" from the bottom, do the following.

(IMPORTANT! Do not allow the tank to become empty!)

1. Remove the lid.
2. Pour 2 gallons of chlorine to the solution tank.
3. Fill the tank with water until the level is about 3" from the top.
4. Replace the lid.

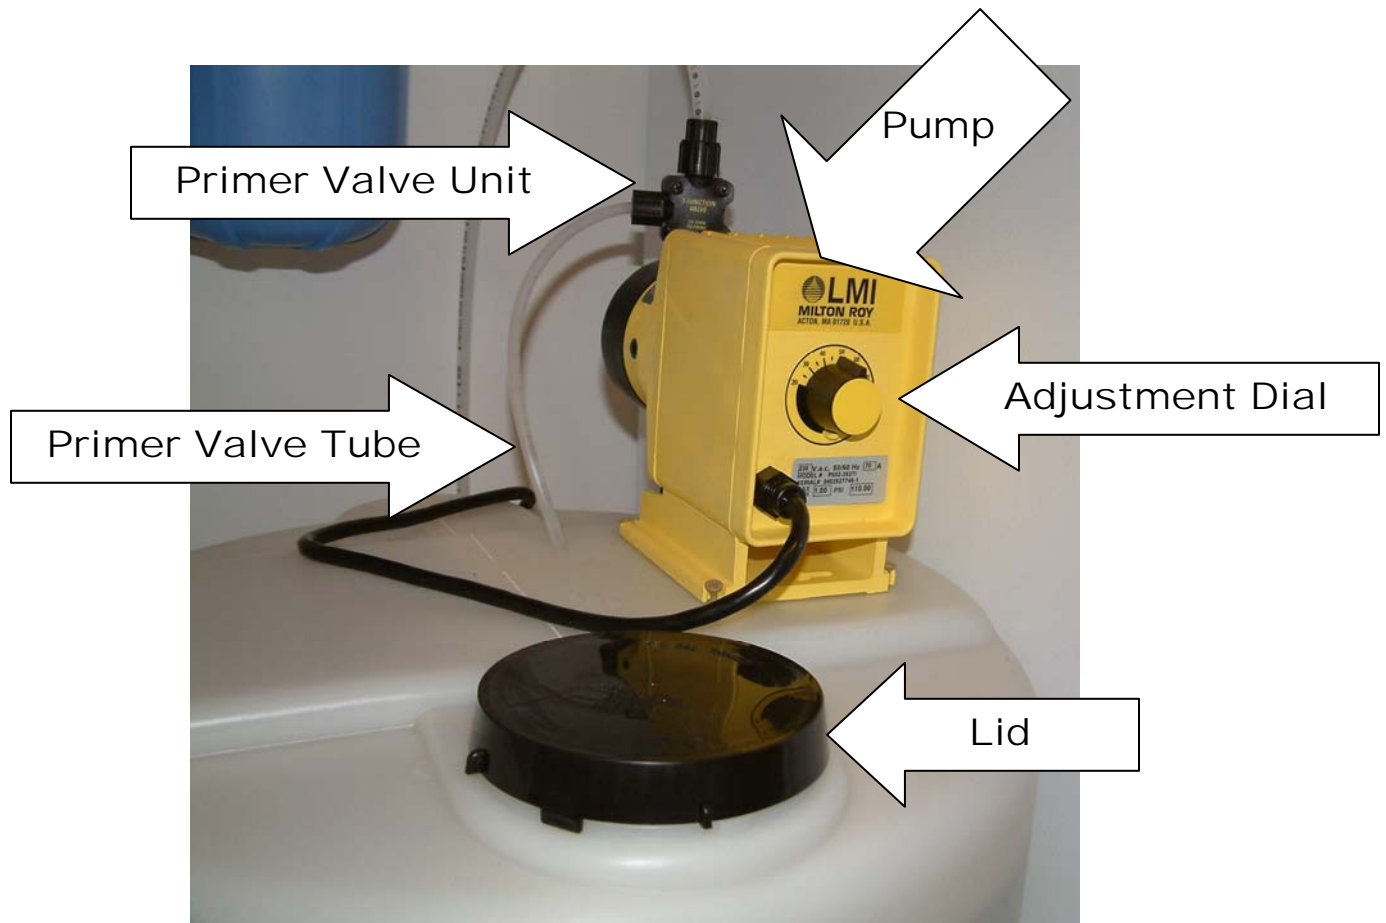

Should you notice that the level does not go down over the period of a week, it may be that the pump has lost its prime. To re-prime the pump, do the following.

1. Turn on a faucet and run water until the chlorinator pump begins to cycle.
2. Pull the smaller priming tube out from its hole in the top of the barrel.
3. Turn the knob on the Primer Valve Unit. As you turn it, you'll feel it move outward and then suddenly drop back inward. Keep turning the knob until its fully outward, then stop.
4. Check to see that a small amount of chlorinated water spurts out from the end of the tube.

Metro Water Filter of the South

Toll free 1-888-604-8043

5. When water spurts from the tube at regular intervals, turn the Primer Valve Knob until it drops back inward.
6. Replace the small primer tube back into its hole in the top of the barrel.
7. Turn off the faucet.